



Superseal Manufacturing Co., Inc.

*SIMULATION PERFORMANCE &
SOLAR HEAT GAIN REPORT*

*"1650"
Fixed*

*NCTL-110-9580-01a
(Revised: 06/10/08)*



NATIONAL CERTIFIED TESTING LABORATORIES

FIVE LEIGH DRIVE • YORK, PENNSYLVANIA 17406 • TELEPHONE (717) 846-1200
FAX (717) 767-4100
www.nctlinc.com

Thermal Performance, Solar Heat Gain Coefficient, Visible Transmittance and Condensation Resistance Calculation Report

REPORT NO: NCTL-110-9580-01a
SIMULATION DATE: 04/06/05
REPORT DATE: 04/06/05
REVISION DATE: 06/10/08

Client: Superseal Manufacturing Co., Inc.
125 Helen St., P. O. Box 795
South Plainfield, NJ 07080

Product Line: Superseal Manufacturing Co., Inc.'s Series "1650" Vinyl Fixed Prime Window

Specification: NFRC 100-2004: "Procedure for Determining Fenestration Product U-Factors".
NFRC 200-2004: "Procedure for Determining Fenestration Product Solar Heat
Gain Coefficients and Visible Transmittance at Normal Incidence".
NFRC 500-2004: "Procedure for Determining Fenestration Product
Condensation Resistance Values".
Therm 5.x / Window 5.x NFRC Simulation Manual (Approved at test date)

Procedures and Compliance: All U-factor, Solar Heat Gain Coefficients, Visible Transmittance and
Condensation Resistance values were calculated using the following
characteristics: a default value of 0.30 solar absorptance for all products other
than window glazed wall and sloped glazing which have a solar absorptance of
0.50. The best glazing option was used as the configuration for SHGC and VT
specialty products table. NCTL is a NFRC accredited simulation laboratory and
this simulation was conducted in full compliance with NFRC requirements.
This report does not constitute an opinion or endorsement by the laboratory.
Ratings values included in this report are for submittal to an NFRC-licensed IA
and are not meant to be used directly for labeling purposes. Only those values
identified on a valid Certification Authorization Report (CAR) by an NFRC
accredited Inspection Agency (IA) are to be used for labeling purposes.
Rounding per IEEE/ASTM SI 10-1997 except section 5.4.1.3. (L.4.9.A.1-6, A.7.a, h.a, 21,
17, 18)

PRODUCT LINE DESCRIPTION

(L.4.9.A.7.a-b, g, h)

General: The product line modeled is Superseal Manufacturing Co., Inc.'s Series "1650"
Vinyl Fixed Prime Window.

Model Size Simulations: 1200mm x 1500mm {47.244" x 59.055"}

ATTACHMENT C

(L.4.9.18)

*Additional Options Added
(06/10/08)*

***Thermal Performance, Solar Heat Gain Coefficient, Visible Transmittance and
Condensation Resistance Calculation Report***

<i>REPORT NO:</i>	<i>NCTL-110-9580-01a</i>
<i>SIMULATION DATE:</i>	<i>04/06/05</i>
<i>REPORT DATE:</i>	<i>04/06/05</i>
<i>REVISED DATE:</i>	<i>06/10/08</i>

Client: *Superseal Manufacturing Co., Inc.
125 Helen St., P. O. Box 795
South Plainfield, NJ 07080*

Product Line: *Superseal Manufacturing Co., Inc.'s Series "1650" Vinyl Fixed Prime Window*

Revision: *Solarban 70XL Additonal options added.*

(L.4.9.A.18)

Individual Product Descriptions and Model Size Matrix of U-Factors

All U-factors are given in BTU/HR/ft²/°F

(L.4.9.A.7 d, e, f, A.8.c, A.12, A.24, NFRC 500 4.4)

Prod #	Glazing Descriptions								U-Factor	CR	Ref. Notes
	Exterior Lite	Gap	Spacer	Center Lite	Gap	Interior Lite	Grids	Glazing ID			
004	Clear – 3mm	0.514" Air	Super Spacer			Clear – 3mm	N, G	4	0.43	45	
005	PPG "Solarban 70XL" (e=0.018) – 3mm	0.514" Air	Super Spacer			Clear – 3mm	N, G	5	0.29	57	
006	PPG "Solarban 70XL" (e=0.018) – 3mm	0.514" Arg	Super Spacer			Clear – 3mm	N, G	6	0.26	61	
007	PPG "Solarban 70XL" (e=0.018) – 3mm	0.514" Arg	Super Spacer			PPG "Solarban 70XL" (e=0.018) – 3mm	N, G	7	0.25	61	
008	PPG "Solarban 70XL" (e=0.018) – 3mm	0.514" Kry	Super Spacer			Clear – 3mm	N, G	8	0.25	63	
009	PPG "Solarban 70XL" (e=0.018) – 3mm	0.514" Kry	Super Spacer			PPG "Solarban 70XL" (e=0.018) – 3mm	N, G	9	0.24	63	


Individual Product Descriptions and Model Size Matrix of SHGC & VT

Solar Heat Gain Coefficient and Visible Transmittance

(L.4.9.A.8.c, A.12, NFRC 500 4.4)

Prod #	Glazing Description							No Dividers		Dividers <1"		Dividers >1"		Ref. Notes
	Exterior Lite	Gap	Spacer	Center Lite	Gap	Interior Lite	Glazing ID	SHGC	VT	SHGC	VT	SHGC	VT	
004	Clear – 3mm	0.514" Air	Super Spacer			Clear – 3mm	4	0.60	0.62	0.54	0.55	0.48	0.49	
005	PPG "Solarban 70XL" (e=0.018) – 3mm	0.514" Air	Super Spacer			Clear – 3mm	5	0.22	0.49	0.20	0.43	0.18	0.38	
006	PPG "Solarban 70XL" (e=0.018) – 3mm	0.514" Arg	Super Spacer			Clear – 3mm	6	0.21	0.49	0.19	0.43	0.17	0.38	
007	PPG "Solarban 70XL" (e=0.018) – 3mm	0.514" Arg	Super Spacer			PPG "Solarban 70XL" (e=0.018) – 3mm	7	0.20	0.38	0.18	0.34	0.16	0.30	
008	PPG "Solarban 70XL" (e=0.018) – 3mm	0.514" Kry	Super Spacer			Clear – 3mm	8	0.21	0.49	0.19	0.43	0.17	0.38	
009	PPG "Solarban 70XL" (e=0.018) – 3mm	0.514" Kry	Super Spacer			PPG "Solarban 70XL" (e=0.018) – 3mm	9	0.20	0.38	0.18	0.34	0.16	0.30	

TEST SPECIMEN COMPLIES
WITH THESE DETAILS.
ANY DEVIATION IS NOTED.
TEST COMPLETE: 04/06/05
NCTL-110-9580-01a

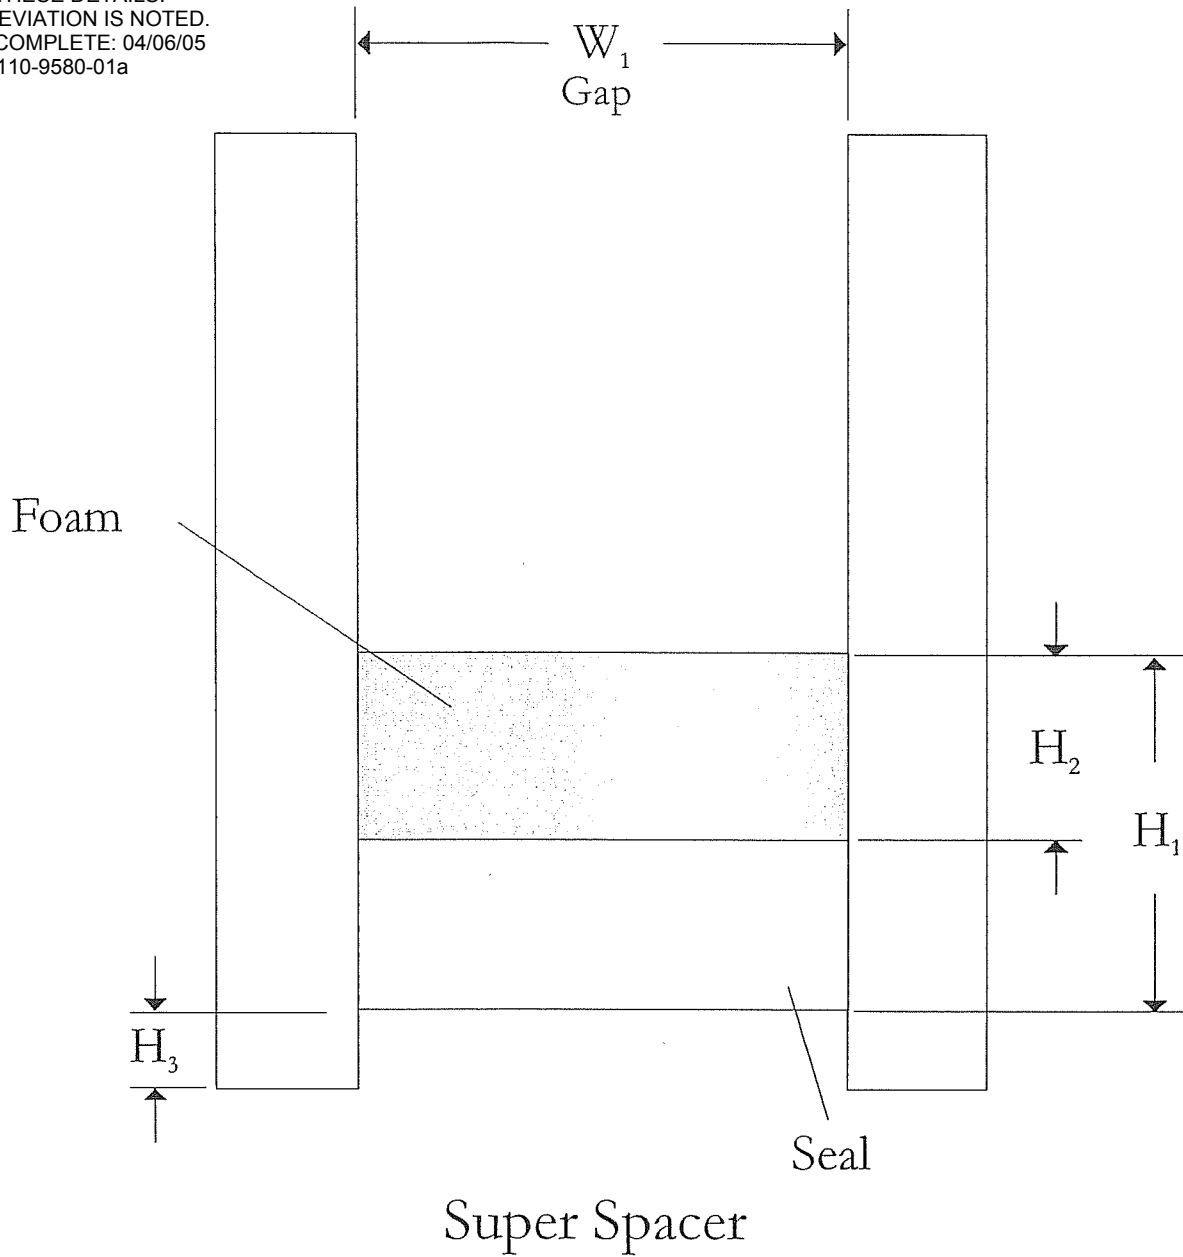

Spacer Dimensions -Fill dimensions where applicable - Please fill out a spacer sheet for each spacer used whether spacer type or size.

Gap	Primary Seal	Secondary Seal	Material	Fill
<input type="checkbox"/> W ₁ <u>.514</u> "	<input checked="" type="checkbox"/> Butyl	<input type="checkbox"/> Butyl	<input type="checkbox"/> Aluminum	<input type="checkbox"/> Dessicant
<input type="checkbox"/> W ₂ _____ "	<input type="checkbox"/> PIB	<input type="checkbox"/> PIB	<input type="checkbox"/> Steel - Mild	<input type="checkbox"/> Air
<input type="checkbox"/> W ₃ _____ "	<input type="checkbox"/> Polysulphide	<input type="checkbox"/> Polysulphide	<input type="checkbox"/> Steel - Stainless	<input type="checkbox"/> Other _____
<input type="checkbox"/> W ₄ _____ "	<input type="checkbox"/> Silicone	<input type="checkbox"/> Silicone	<input type="checkbox"/> Steel - Galvanized	
<input type="checkbox"/> H ₁ <u>.375</u> "	<input type="checkbox"/> Urethane	<input type="checkbox"/> Urethane	<input type="checkbox"/> Vinyl	
<input type="checkbox"/> H ₂ <u>.188</u> "	<input type="checkbox"/> None	<input type="checkbox"/> None	<input type="checkbox"/> Foam _____	
<input type="checkbox"/> H ₃ _____ "	<input type="checkbox"/> Other _____	<input type="checkbox"/> Other _____	<input type="checkbox"/> Other _____	
<input type="checkbox"/> H ₄ _____ "				
<input type="checkbox"/> H ₅ _____ "				
<input type="checkbox"/> T ₁ _____ "				